


CURRENT IN AMPERES

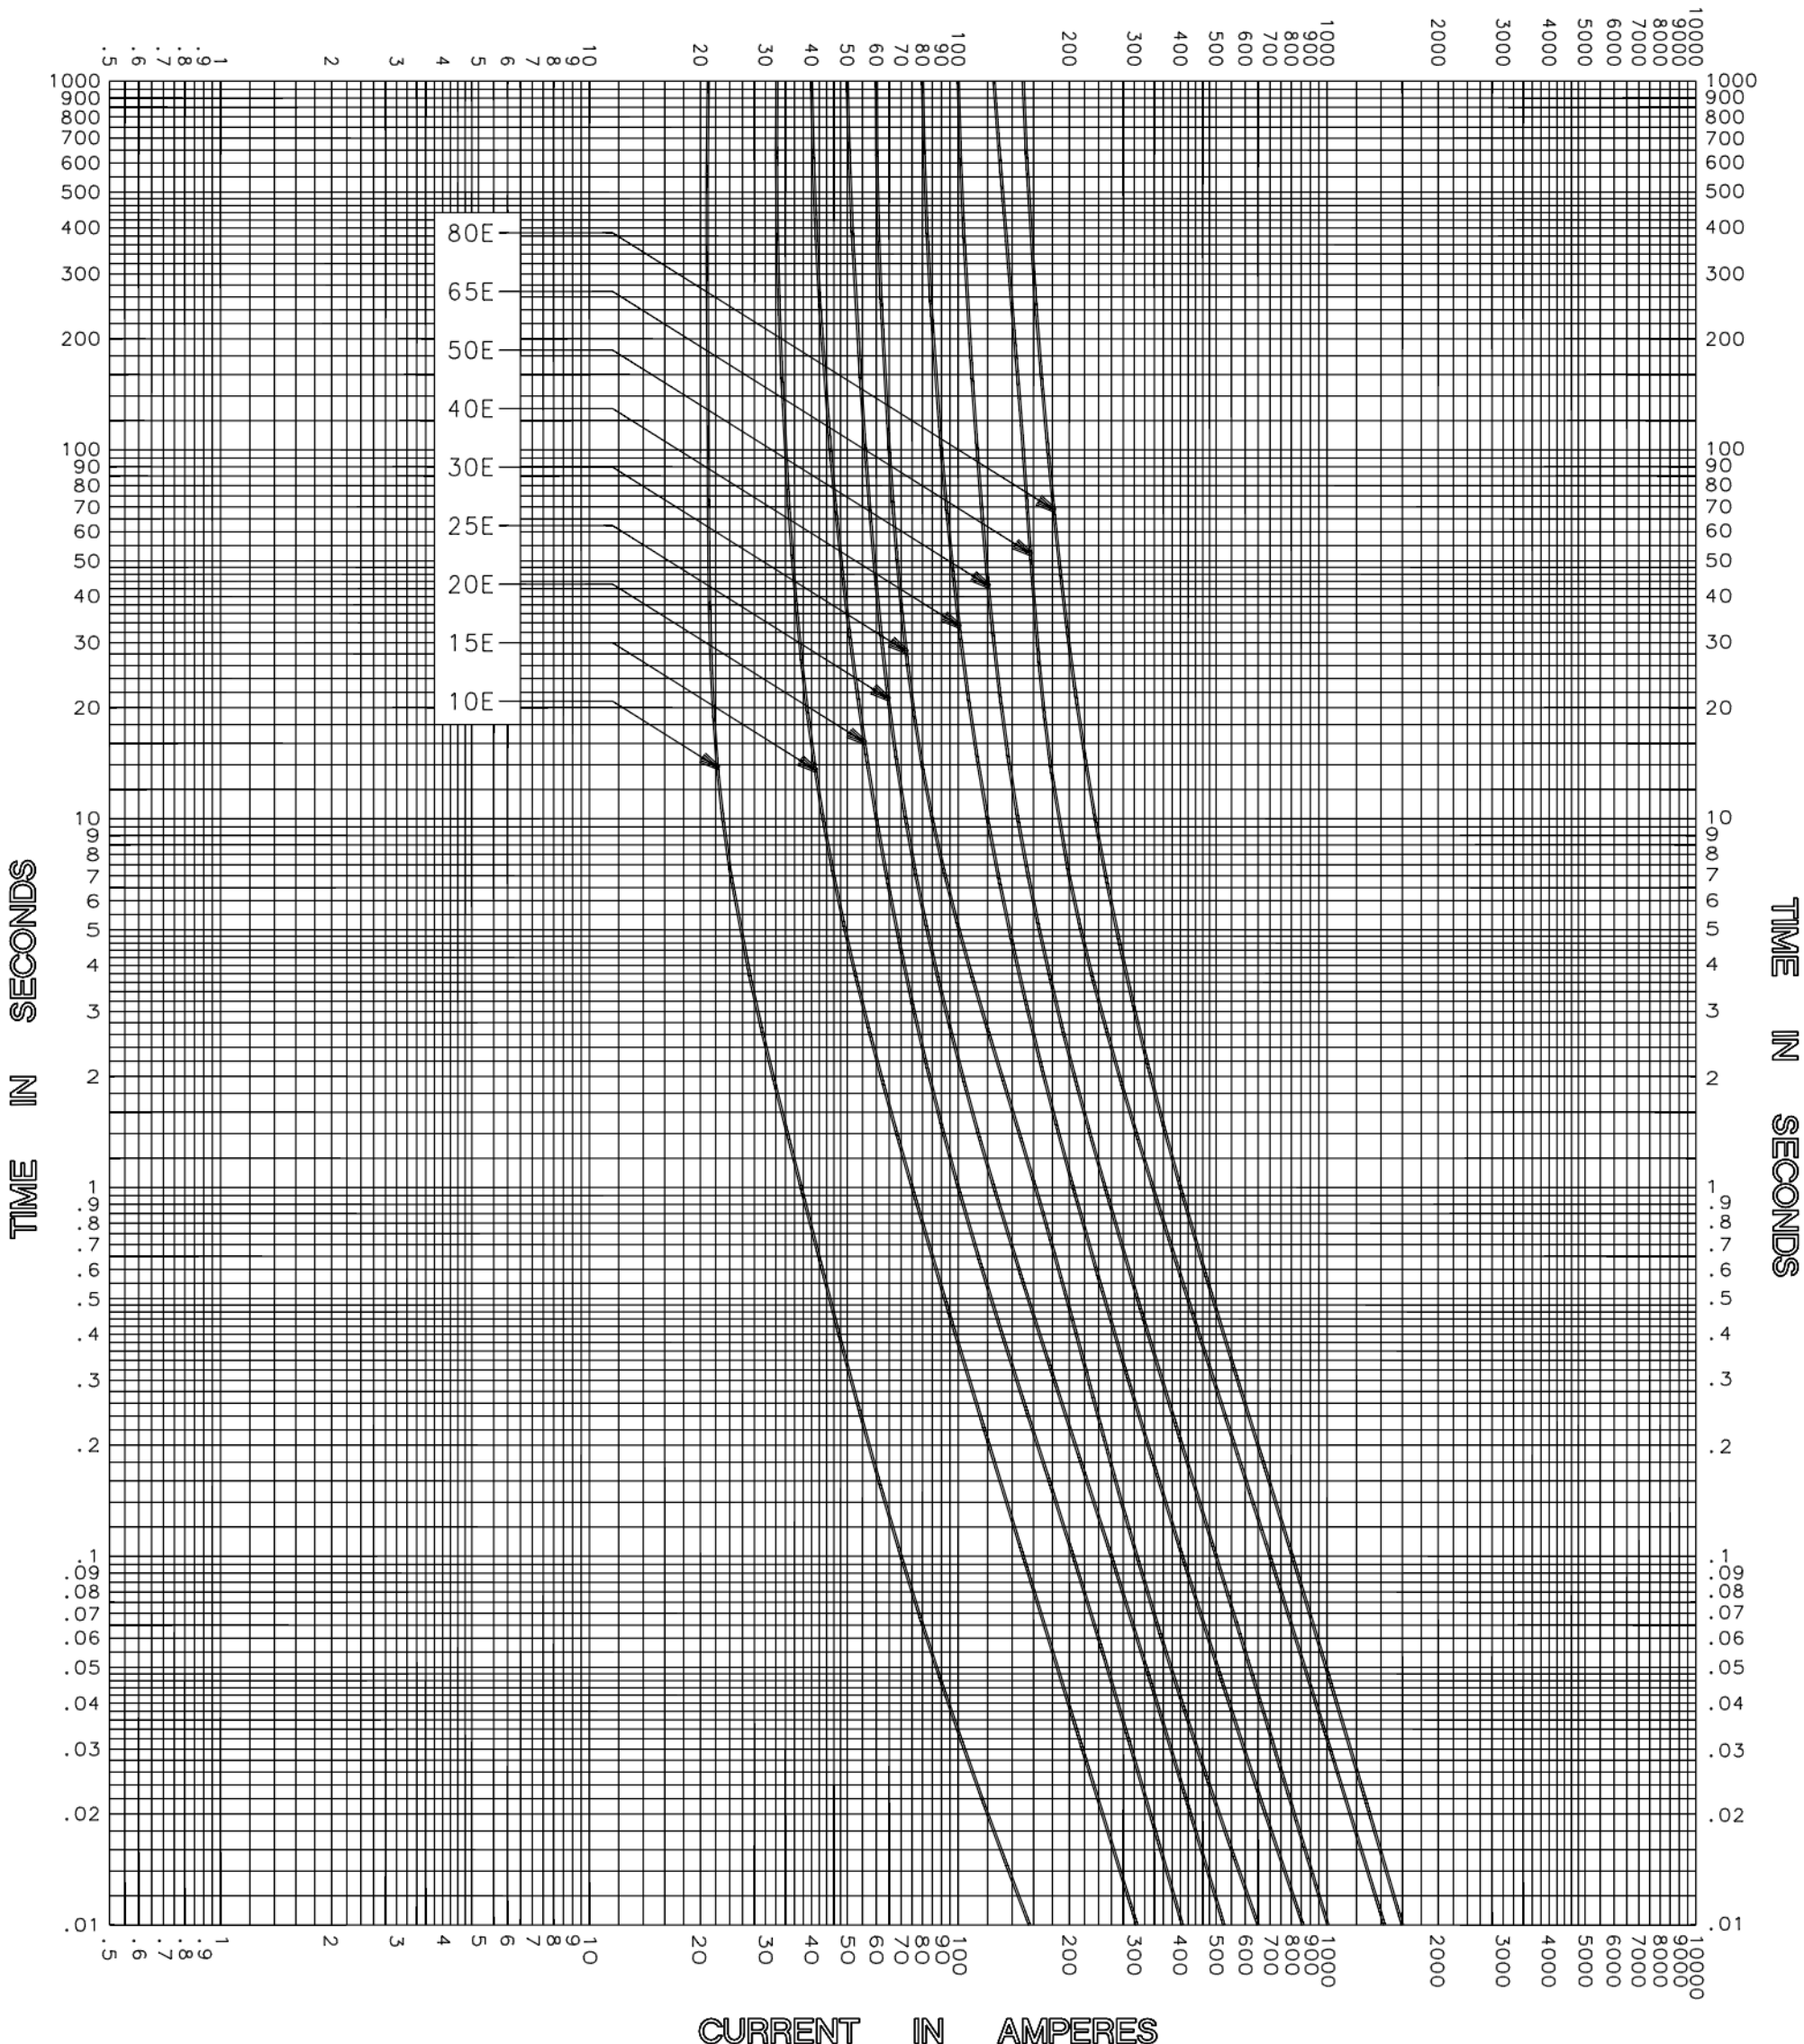

MELTING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 2.75kV E-RATED 10E-80E
BASIS FOR DATA _____	


 DES PLAINES, ILLINOIS 60016
TIME CURRENT CHARACTERISTIC CURVES

DRAWN BY LLL
DATE 04/26/04
CHECKED BY MP
DRAWING NO. A-FCC03 001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT