


CURRENT IN AMPERES

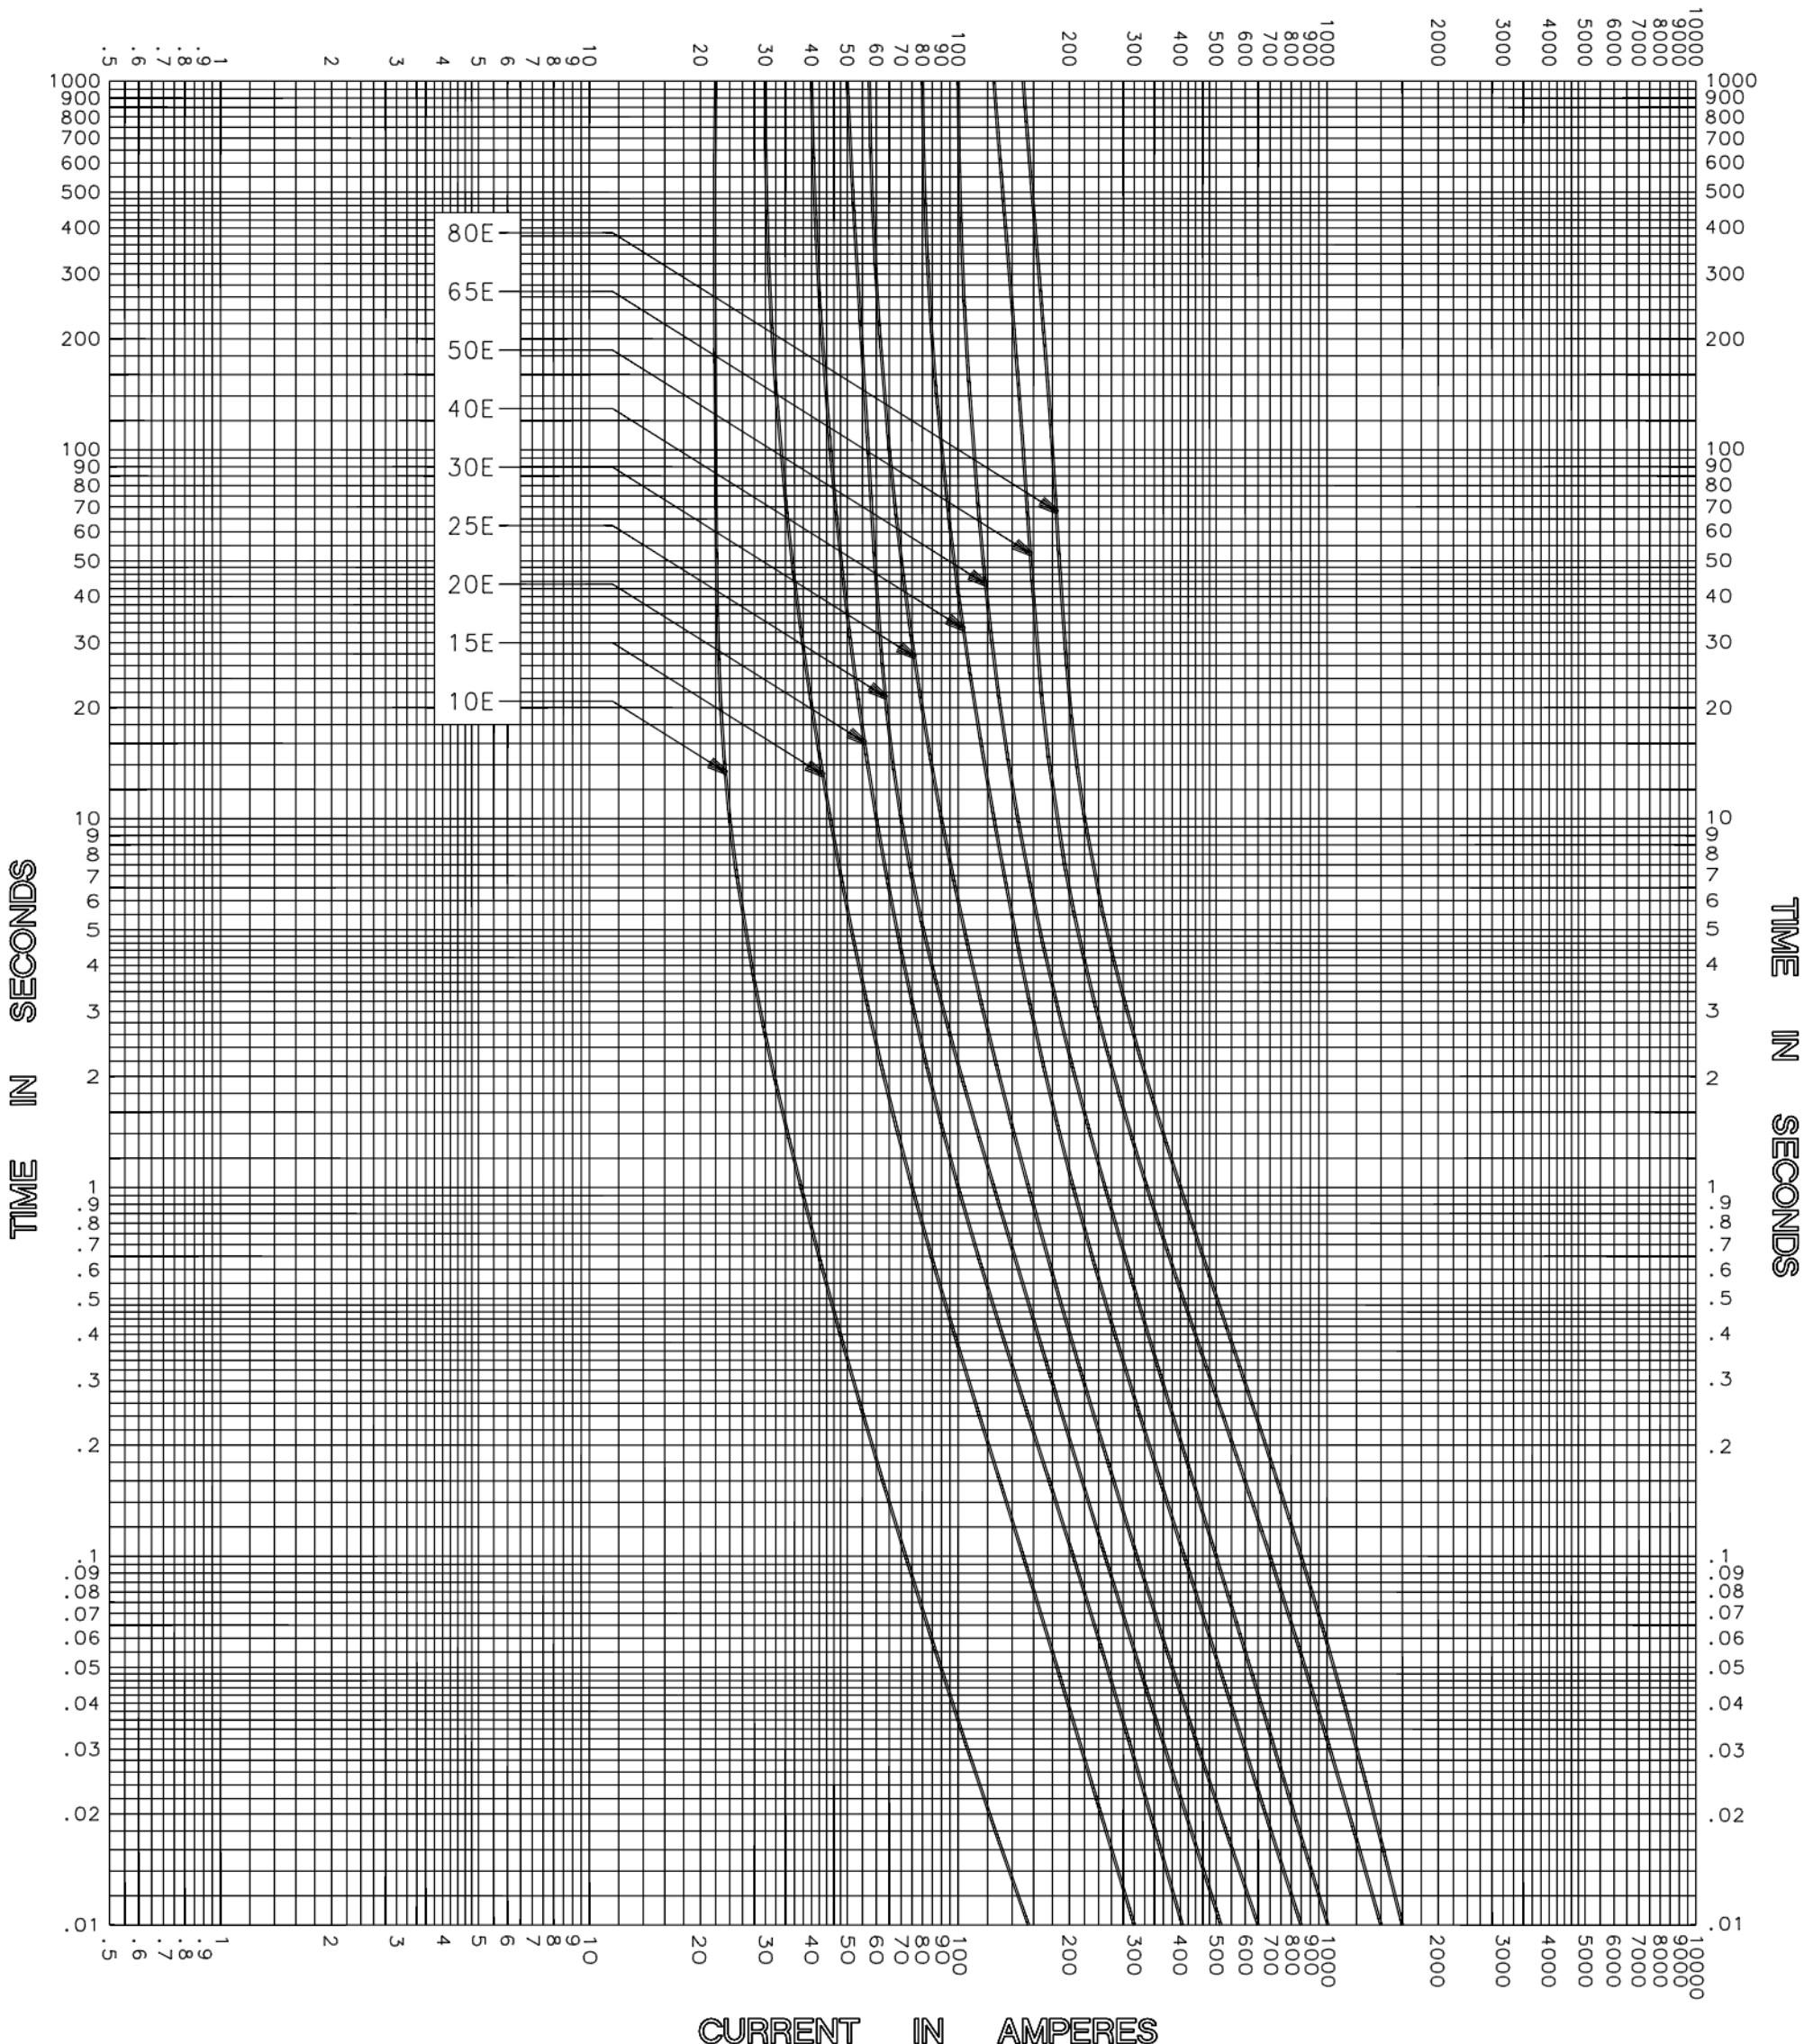

MELTING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 8.25kV E-RATED 10E-80E
BASIS FOR DATA _____	

 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>07/26/04</u> CHECKED BY <u>MP</u>
	DRAWING NO. A-FCC03 25001

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT