


CURRENT IN AMPERES

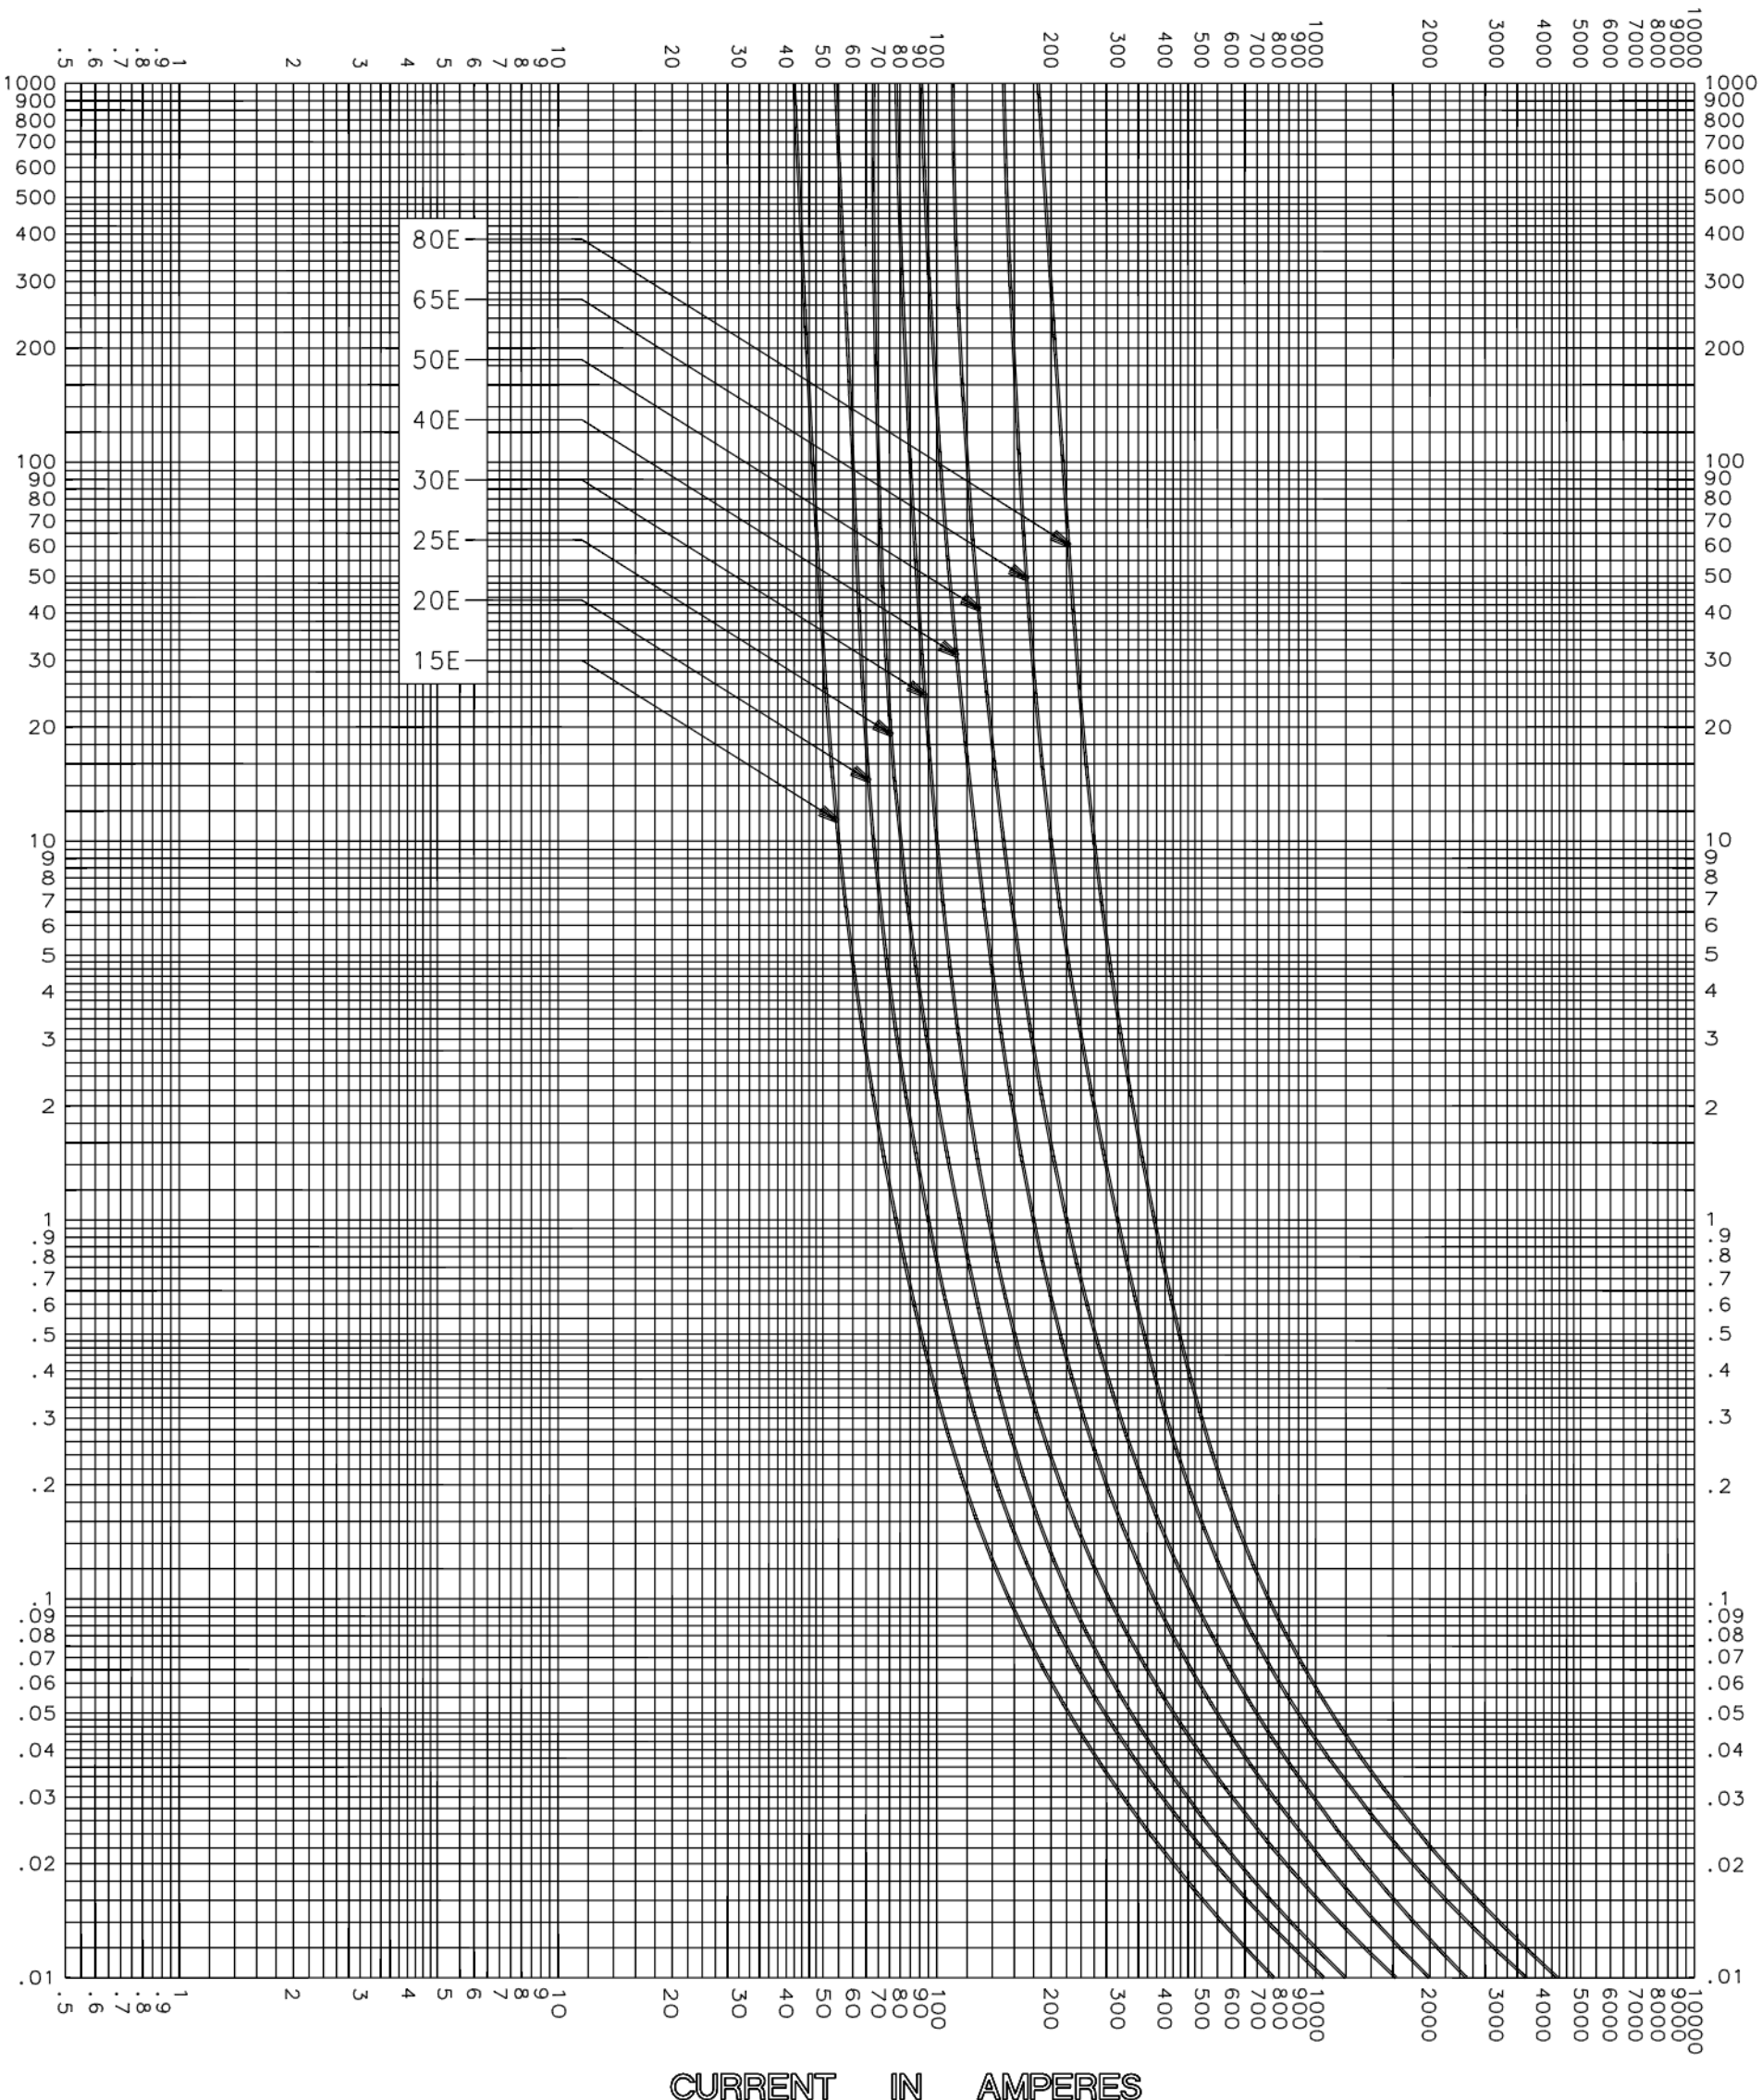

CLEARING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 38.0kV E-RATED 15E-80E
BASIS FOR DATA _____	

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL DATE 05/21/04 CHECKED BY MP
	DRAWING NO. A-FCC04 001

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT