


CURRENT IN AMPERES



CLEARING TIME CHARACTERISTIC

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		15.5kV E-RATED 100E-300E

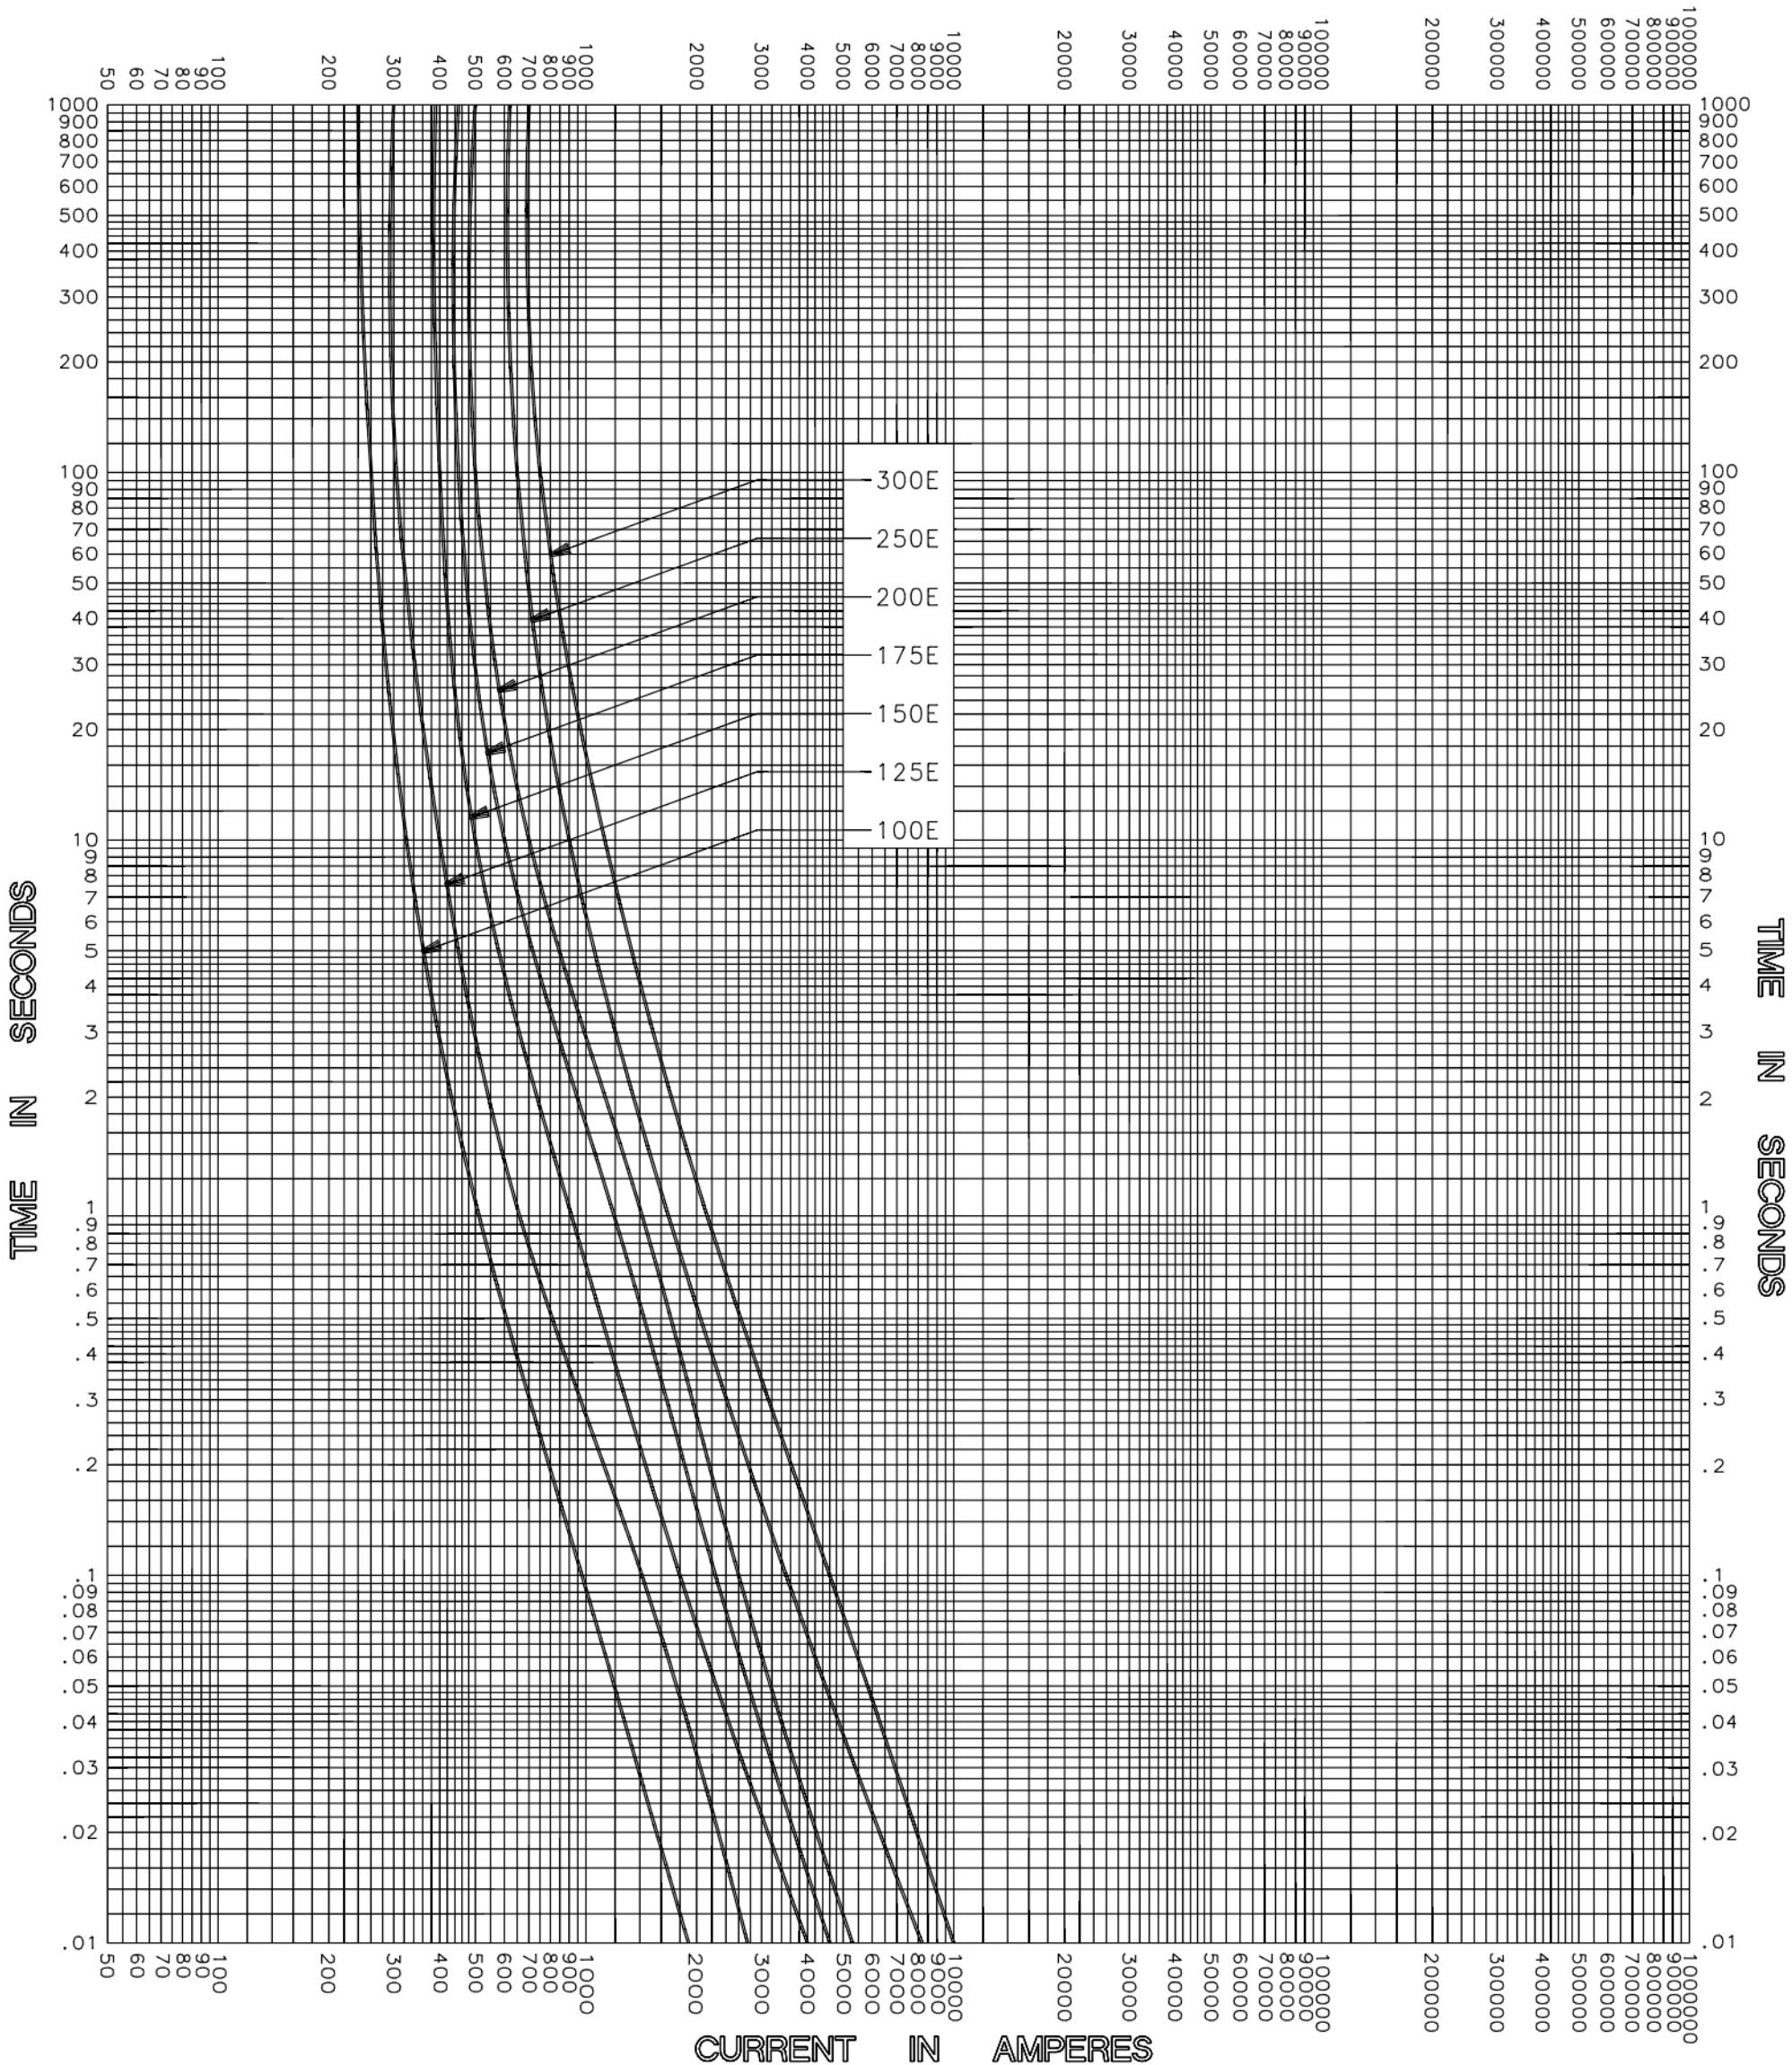

DRAWN BY	LLL
DATE	05/17/04
CHECKED BY	MP
DRAWING NO.	A-FCC0415-5E-002

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT