


CURRENT IN AMPERES

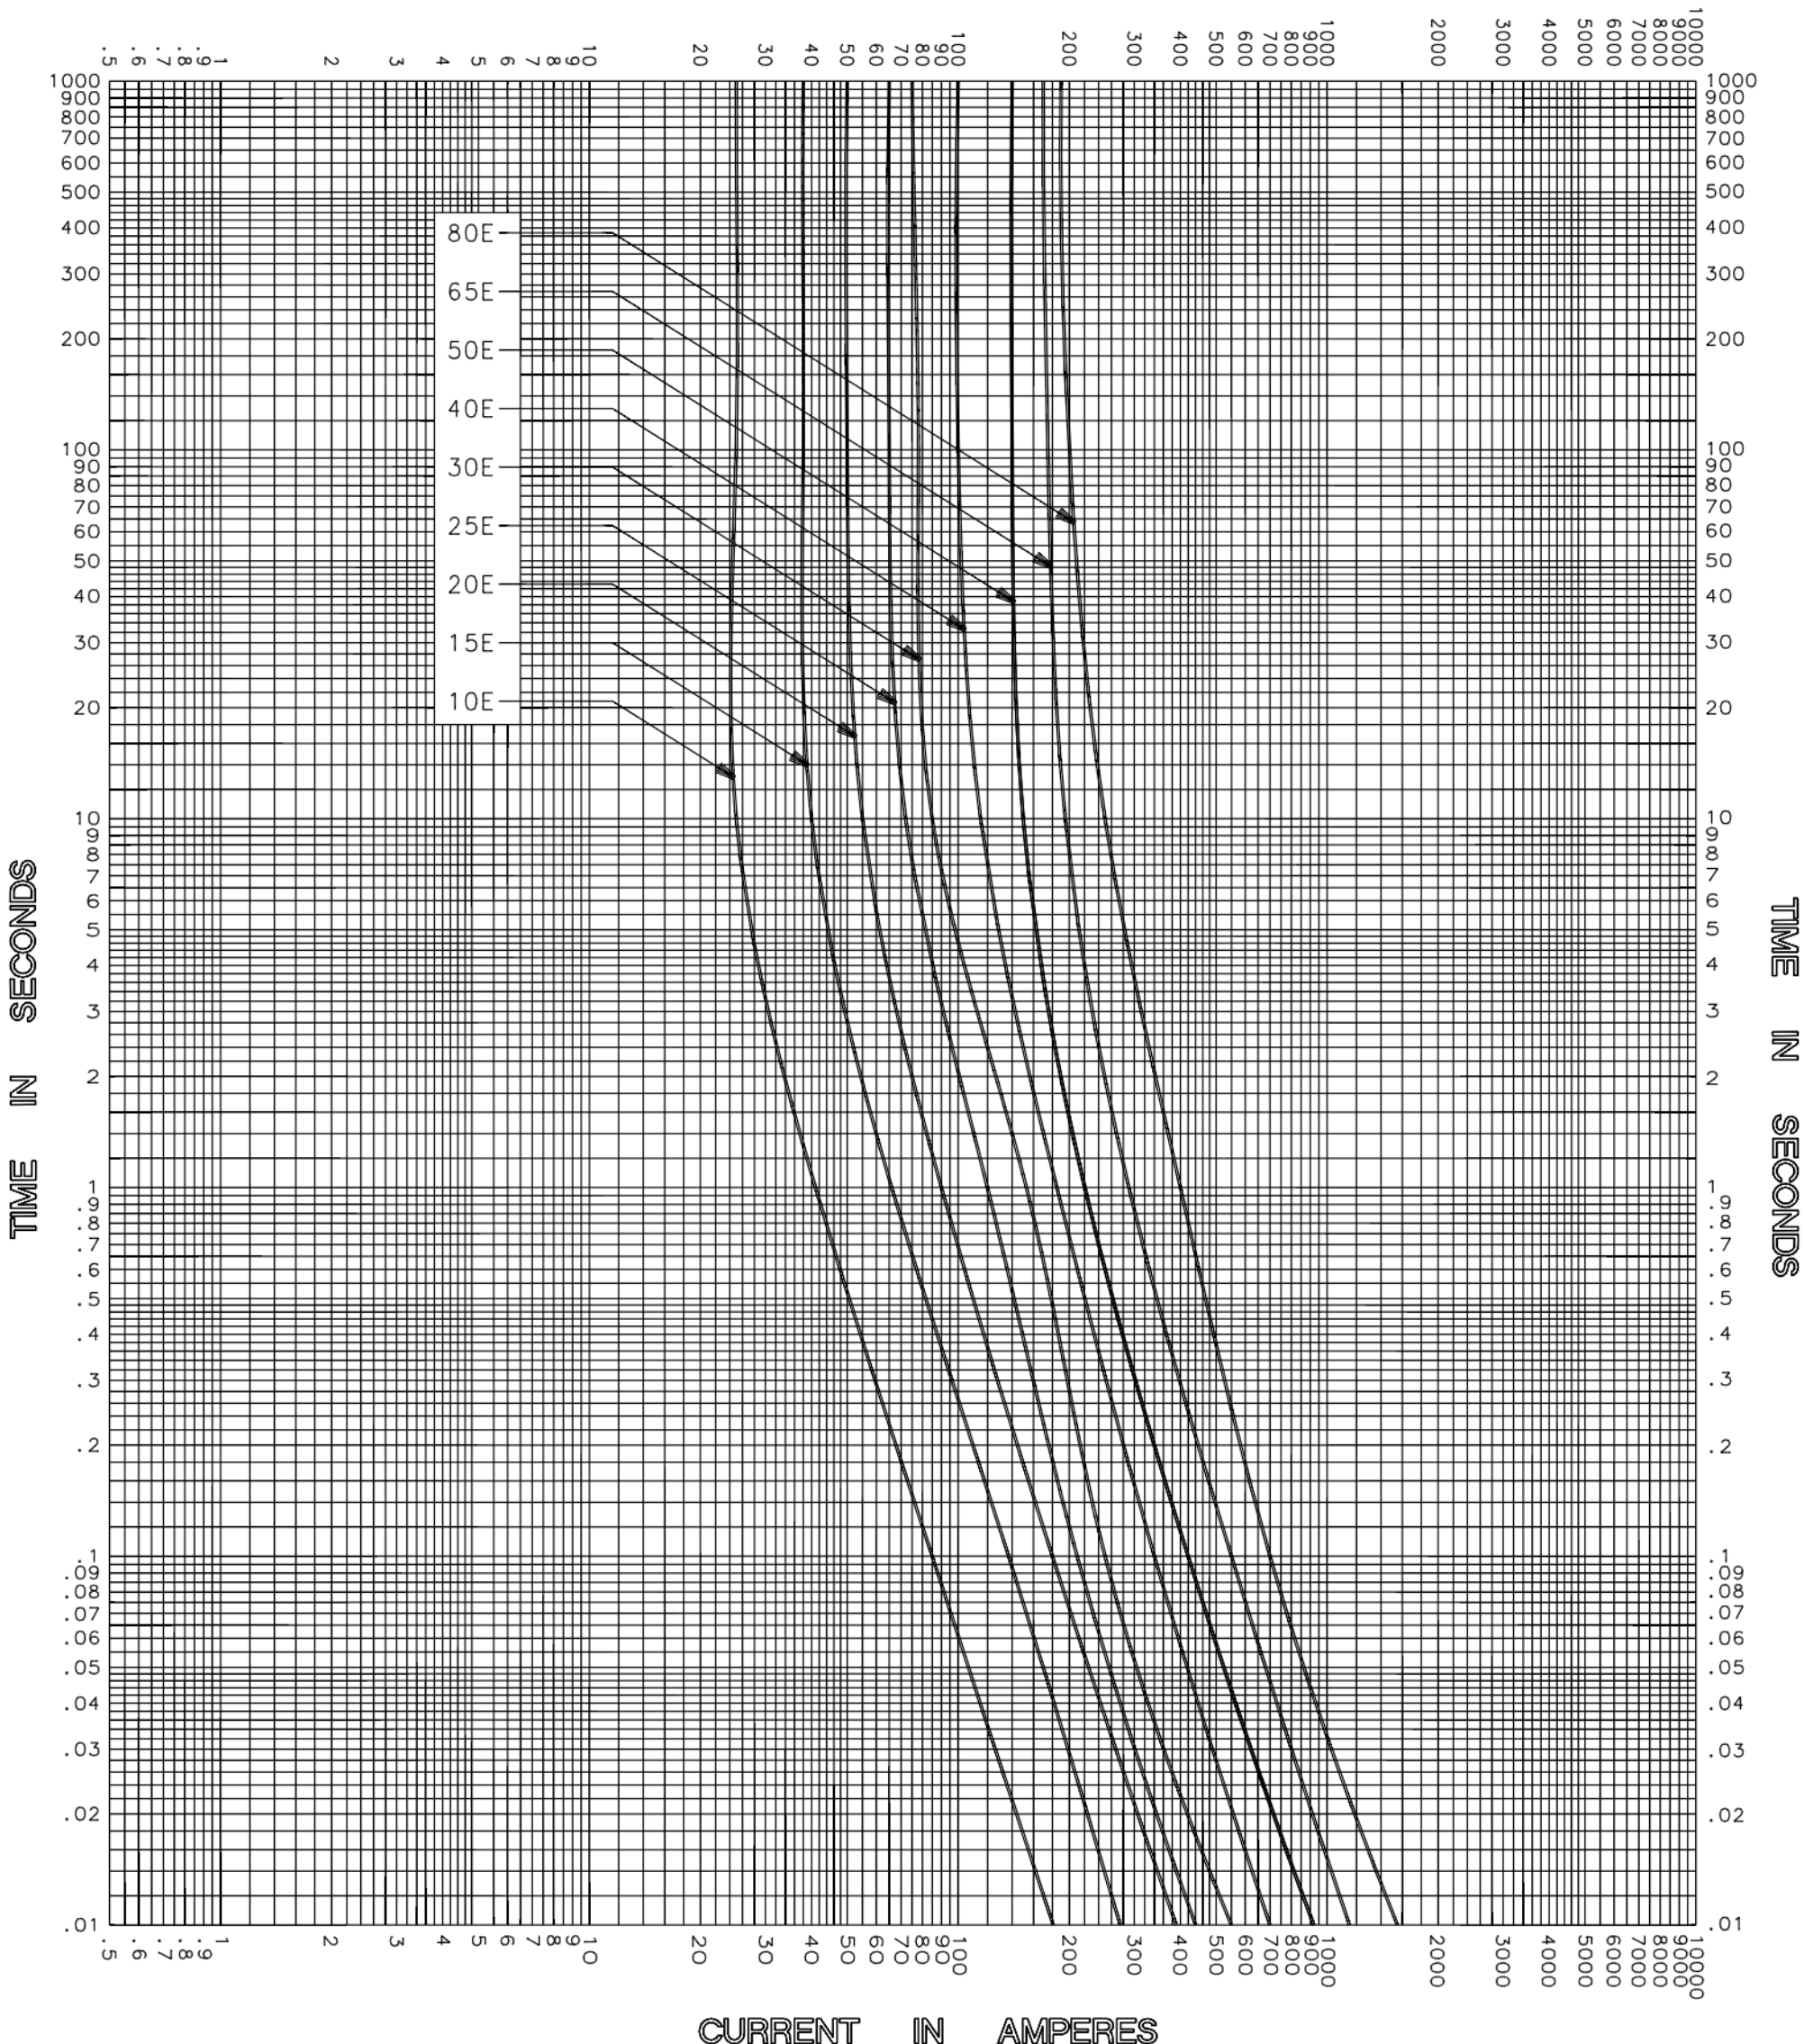

CLEARING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 15.5kV E-RATED 10E-80E
BASIS FOR DATA _____	

  
 DES PLAINES, ILLINOIS 60016  
**TIME CURRENT CHARACTERISTIC CURVES**

DRAWN BY LLL
DATE 05/17/04
CHECKED BY MP
DRAWING NO. A-FCC04 001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT