


CURRENT IN AMPERES

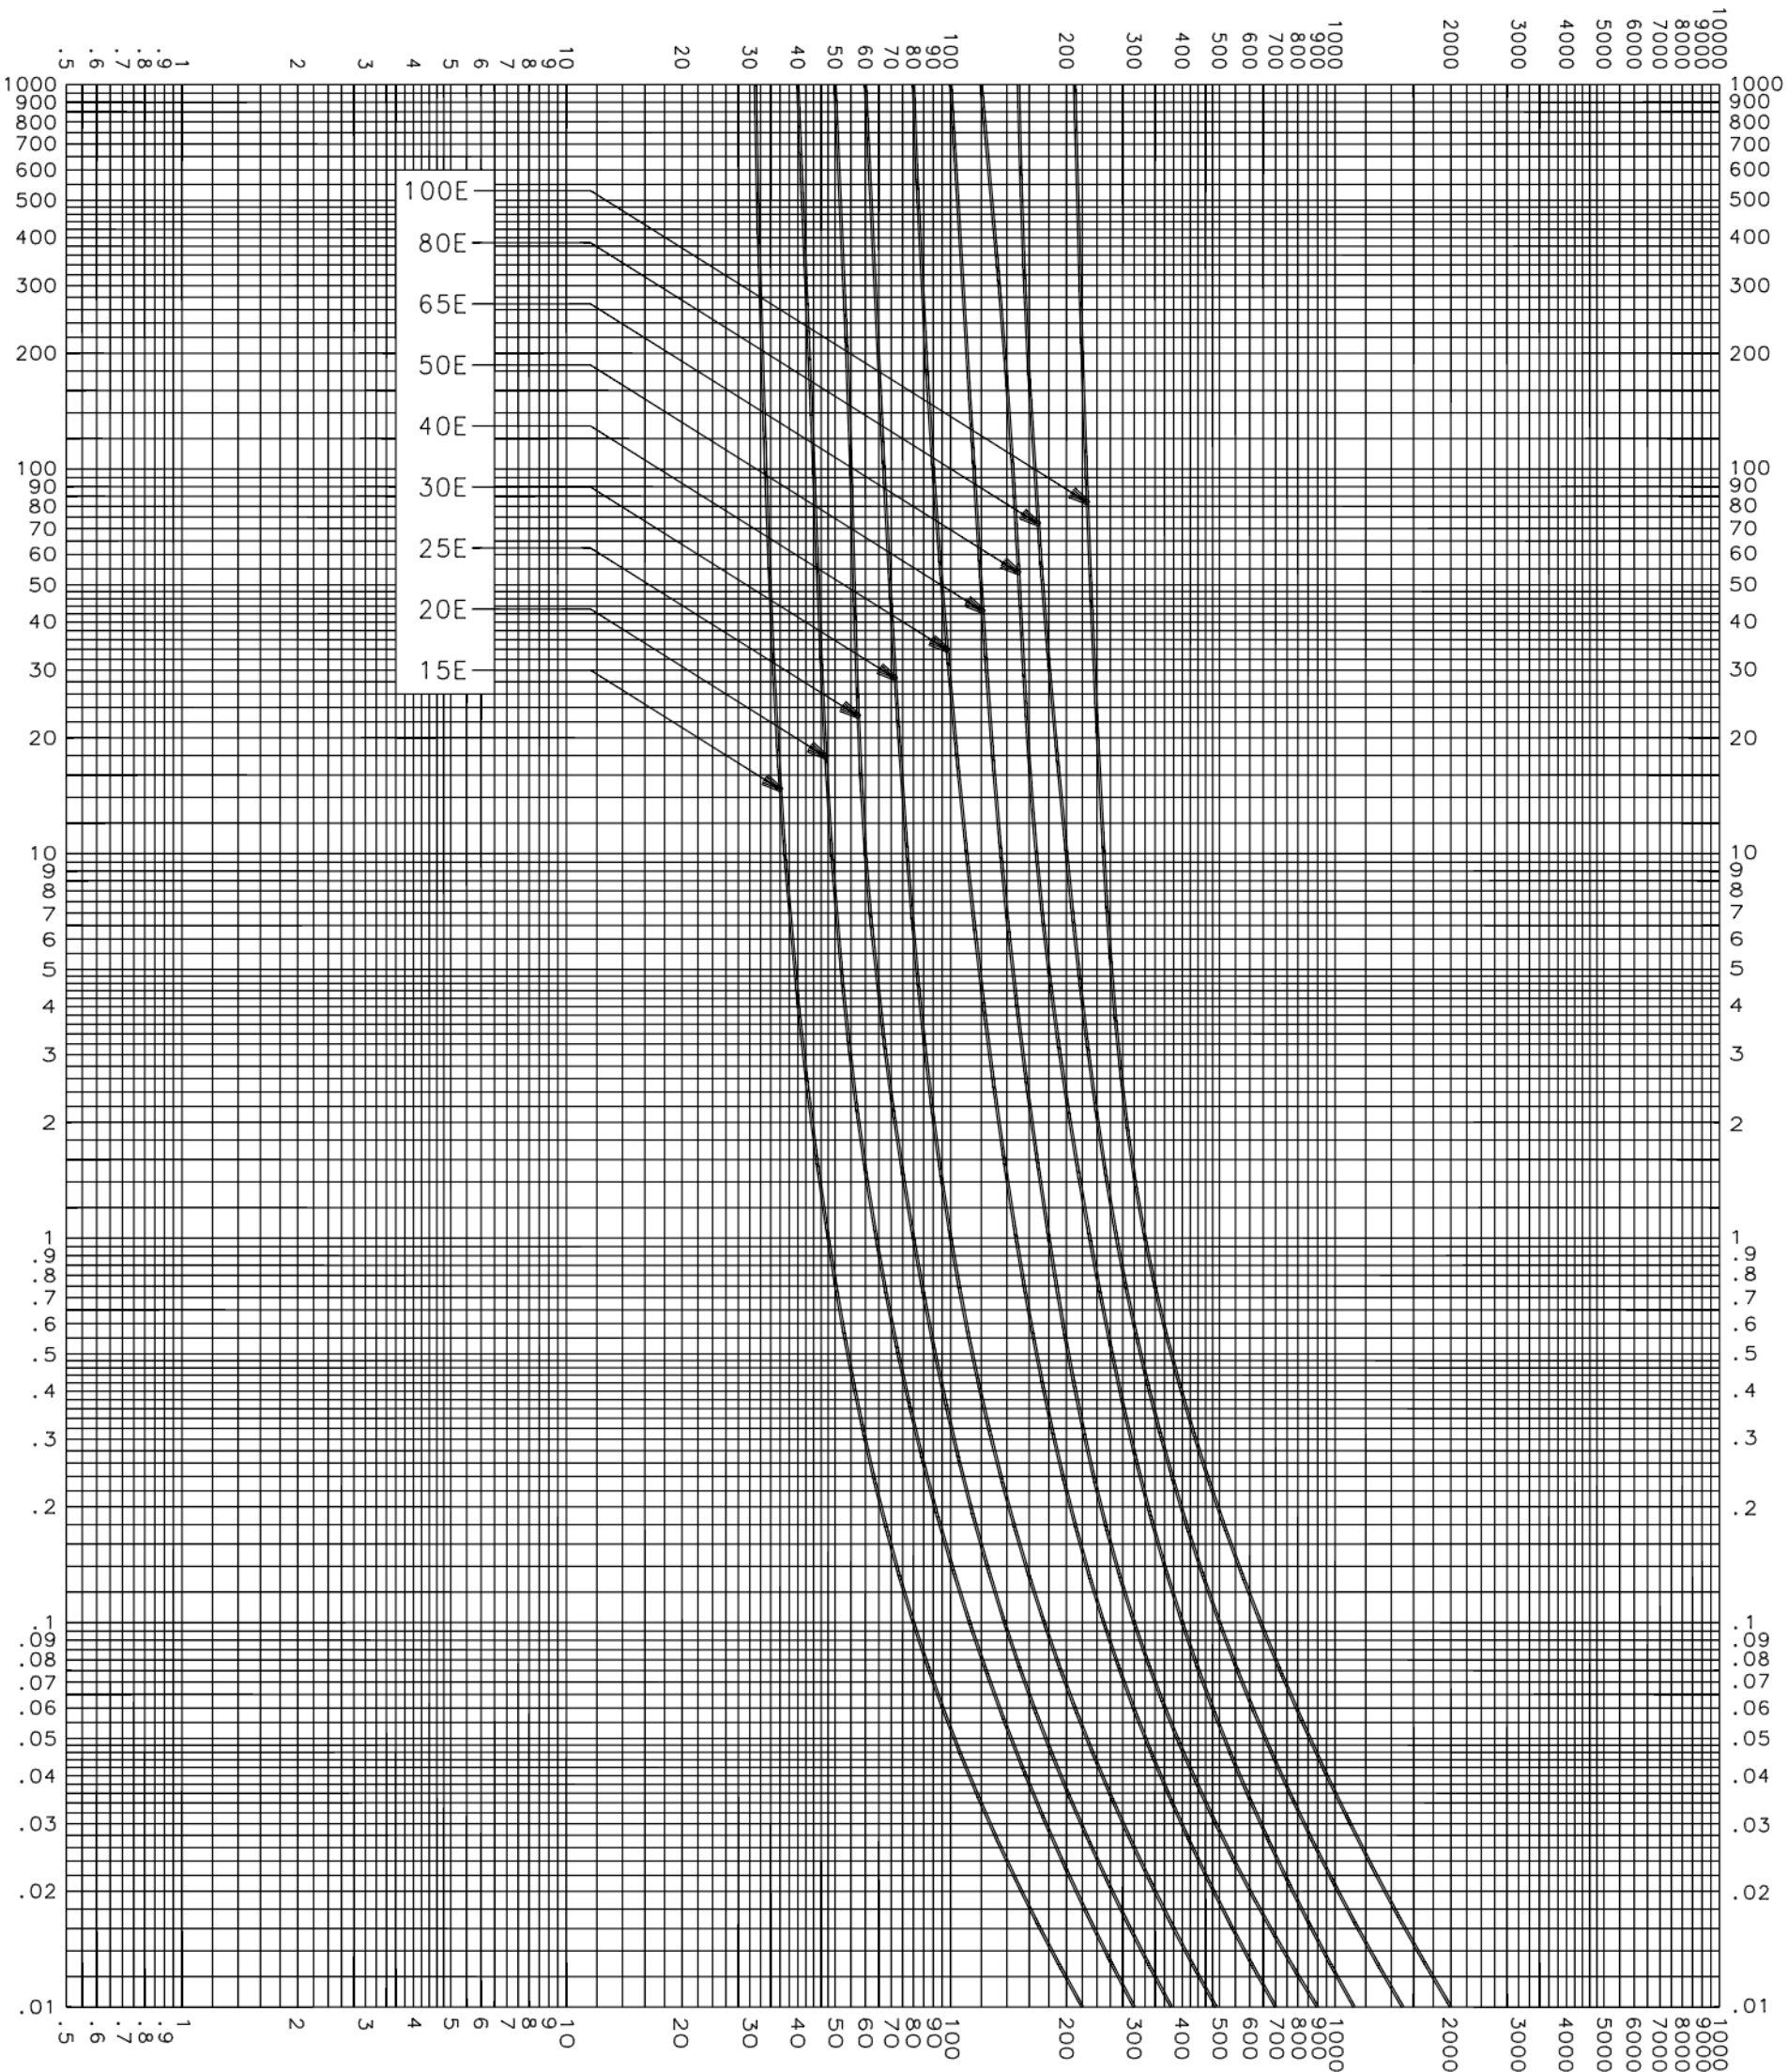

CURRENT IN AMPERES

MELTING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 25.8kV E-RATED 15E-100E
BASIS FOR DATA _____	

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL DATE 07/22/04 CHECKED BY MP
	DRAWING NO. A-FCC03

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT