

# Series HPP 601-1351 DN32 PN315



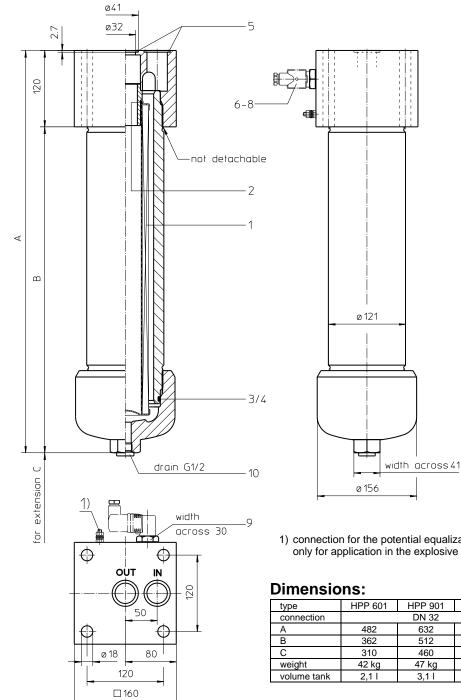

type	HPP 601	HPP 901	HPP 1351	
connection		DN 32		
A	482	632	880	
В	362	512	760	
С	310	460	710	
weight	42 kg	47 kg	58 kg	
volume tank	2,1 l	3,1 I	4,6 I	



Dimensions: mm

Designs and performance values are subject to change.

## **Pressure Filter** Series HPP 601-1351 DN32 PN315

## **Description:**

Pressure filter series HPP 601-1351 have a working pressure up to 315 bar. Pressure peaks can be absorbed with a sufficient safety margin. The HPP-filters are flange to the mounting-surface.

The filter element consists of star-shaped, pleated filter material, which is supported on the inside by a perforated core tube and is bonded to the end caps with a high-quality adhesive. The flow direction is from outside to inside. Filter elements are available down to 4 µm<sub>(c)</sub>. Finer filtration is available upon request.

For cleaning the stainless steel mesh element (see special leaflets 21070-4 and 39448-4) or changing the filter element, remove the pipe plug and take out the element. The mesh elements are not guaranteed to maintain 100% performance after cleaning.

Eaton filter elements are known for high intrinsic stability and an excellent filtration capability, a high dirt-retaining capacity and a long service life.

Eaton filter elements are available up to a pressure resistance of  $\Delta p$  160 bar and a rupture strength of  $\Delta p$  250 bar.

Eaton filter can be used for petroleum-based fluids, HW emulsions, water glycols, most synthetic fluids and lubrication fluids. Consult factory for specific fluid applications.

The internal valve is integrated into the filter head. After reaching the bypass pressure setting, the bypass valve will send unfiltered partial flow around the filter.

The reversing valve provides another level of protection for the filter element. The reverse flow will not be filtered.

## Type index:

## Complete filter: (ordering example)

HPP.	901.	10VG.	HR.	Ε.	Ρ.		Ρ.	6.			AE.
1	2	3	4	5	6	7	8	9	10	11	12

- 1 series HPP = pressure filter, manifold mounted
- 2 nominal size: 601, 901, 1351

#### 3 filter material:

80G, 40G, 25G stainless steel wire mesh 25VG, 16VG, 10VG, 6VG, 3VG microglass

#### 4 filter element collapse rating:

#### 30 = ∆p 30 bar

HR =  $\Delta p$  160 bar (rupture strength  $\Delta p$  250 bar)

## 5 filter element design:

= single-end open Е

#### 6 sealing material:

- Р = Nitrile (NBR)
- = Viton (FPM)

#### 7 filter element specification:

- = standard VA = stainless steel
- IS06 = for HFC application, see sheet-no. 31601

## 8 process connection:

Р

= manifold mounted

#### 9 process connection size: = DN32 6

#### 10 filter housing specification:

= standard

IS06 = for HFC application, see sheet-no. 31605

#### 11 internal valve:

- = without
- S1 = with by-pass valve  $\Delta p$  3.5 bar S2
  - = with by-pass valve ∆p 7,0 bar
- = with reversing valve, Q ≤ 465,348 l/min R

#### 12 clogging indicator or clogging sensor:

- = without AOR = visual, see sheet-no. 1606
- AOC = visual, see sheet-no. 1606
- AE = visual-electric, see sheet-no. 1615 VS5 = electronic, see sheet-no. 1619

To add an indicator/sensor to your filter, use the corresponding indicator data sheet to find the indicator details and add them to the filter assembly model code.

## Filter element: (ordering example)

	010111		Joining	слап	ipic)				
01E.	900.	10VG.	HR.	Ε.	Ρ.	-			
1	2	3	4	5	6	7			
1 se		ilter eleme	nt acco	ording	g to c	ompa	any sta	andaro	ł

2 **nominal size:** 600, 900, 1350

.

3 - 7 see type index-complete filter

## **Technical data:**

operating temperature: operating medium: max. operating pressure: test pressure: process connection: housing material: sealing material: installation position: -10°C to +100°C mineral oil, other media on request 315 bar 450 bar manifold mounted C-steel Nitrile (NBR) or Viton (FPM), other materials on request vertical

Classified under the Pressure Equipment Directive 2014/68/EU for mineral oil (fluid group 2), Article 4, Para. 3. Classified under ATEX Directive 2014/34/EU according to specific application (see questionnaire sheet-no. 34279-4).

## Pressure drop flow curves:

## Filter calculation/sizing

The pressure drop of the assembly at a given flow rate Q is the sum of the housing  $\Delta p$  and the element  $\Delta p$  and is calculated as follows:

 $\Delta p$  assembly =  $\Delta p$  housing +  $\Delta p$  element  $\Delta p$  housing = (see  $\Delta p = f(Q)$  - characteristics)

$$\Delta p \text{ Element (mbar)} = Q \left(\frac{l}{min}\right) x \frac{MSK}{10} \left(\frac{mbar}{l/min}\right) x v \left(\frac{mm^2}{s}\right) x \frac{p}{0.876} \left(\frac{kg}{dm^3}\right)$$

For ease of calculation our Filter Selection tool is available online at: www.eaton.com/hydraulic-filter-evaluation


## Material gradient coefficients (MSK) for filter elements

The material gradient coefficients in mbar/(I/min)apply to mineral oil (HLP) with a density of 0,876 kg/dm<sup>3</sup> and a kinematic viscosity of 30 mm<sup>2</sup>/s (139 SUS). The pressure drop changes proportionally to the change in kinematic viscosity and density.


HPP			VG	G				
	3VG	6VG	10VG	16VG	25VG	25G	40G	80G
601	0,776	0,539	0,345	0,300	0,205	0,0247	0,0231	0,0158
901	0,538	0,374	0,239	0,208	0,142	0,0155	0,0144	0,0099
1351	0,336	0,233	0,149	0,130	0,089	0,0100	0,0093	0,0064

## $\Delta p = f(Q) - characteristics according to ISO 3968$

The pressure drop characteristics apply to mineral oil (HLP) with a density of 0,876 kg/dm<sup>3</sup>. The pressure drop changes proportionally to the density.

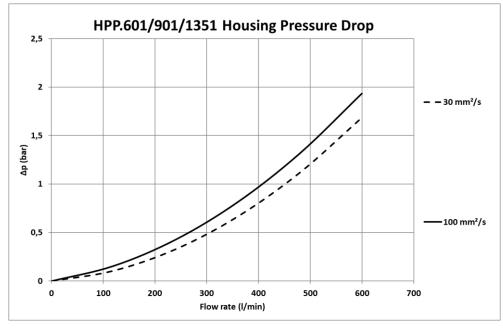

## Symbols:

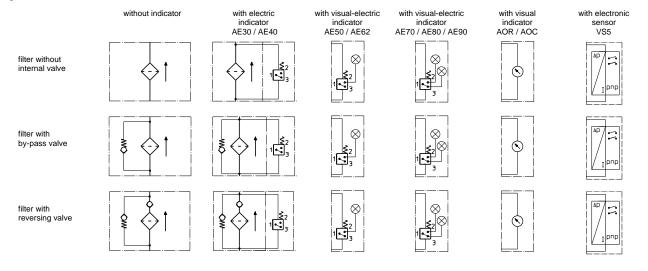

## Spare parts:

item	qty.	designation		dimension			article-no.			
		-	HPP 601	HPP 901	HPP 1351					
1	1	filter element	01E.600	01E.600 01E.900 01E.1350						
2	1	O-ring		48 x 3		304357 (NBR)	304404 (FPM)			
3	1	O-ring		98 x 4			304765 (FPM)			
4	1	support ring		110 x 3,5 x 2			304802			
5	2	O-ring		34 x 3,5			304730 (FPM)			
6	1	clogging indicator visual		AOR or AOC			t-no. 1606			
7	1	clogging indicator visual-electric		AE			t-no. 1615			
8	1	clogging sensor electronic		VS5			t-no. 1619			
9	1	screw plug		20913-4			20913-4 309817			817
10	1	filter element		G 1⁄2			678			

item 9 execution only without clogging indicator or clogging sensor

## Test methods:

Filter elements are tested according to the following ISO standards:

- ISO 2941 Verification of collapse/burst resistance
- ISO 2942 Verification of fabrication integrity
- ISO 2943 Verification of material compatibility with fluids
- ISO 3723 Method for end load test
- ISO 3724 Verification of flow fatigue characteristics
- ISO 3968 Evaluation of pressure drop versus flow characteristics ISO 16889
  - Multi-pass method for evaluating filtration performance

#### North America

44 Apple Street Tinton Falls, NJ 07724 Toll Free: 800 656-3344 (North America only) Tel: +1 732 212-4700

#### Europe/Africa/Middle East

Auf der Heide 2 53947 Nettersheim, Germany Tel: +49 2486 809-0

Friedensstraße 41 68804 Altlußheim, Germany Tel: +49 6205 2094-0

An den Nahewiesen 24 55450 Langenlonsheim, Germany Tel: +49 6704 204-0

#### Grater China No. 7, Lane 280,

Linhong Road Changning District, 200335 Shanghai, P.R. China Tel: +86 21 5200-0099

#### Asia-Pacific

100G Pasir Panjang Road #07-08 Interlocal Centre Singapore 118523 Tel: +65 6825-1668

#### For more information, please email us at filtration@eaton.com or visit www.eaton.com/filtration

© 2021 Eaton. All rights reserved. All trademarks and registered trademarks are the property of their respective owners. All information and recommendations appearing in this brochure concerning the use of products described herein are based on tests believed to be reliable. However, it is the user's responsibility to determine the suitability for his own use of such products. Since the actual use by others is beyond our control, no guarantee, expressed or implied, is made by Eaton as to the effects of such use or the results to be obtained. Eaton assumes no liability arising out of the use by others of such products. Nor is the information herein to be construed as absolutely complete, since additional information may be necessary or desirable when particular or exceptional conditions or circumstances exist or because of applicable laws or government regulations.

