


CURRENT IN AMPERES



CLEARING TIME CHARACTERISTIC

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		2.75kV E-RATED 100E-400E

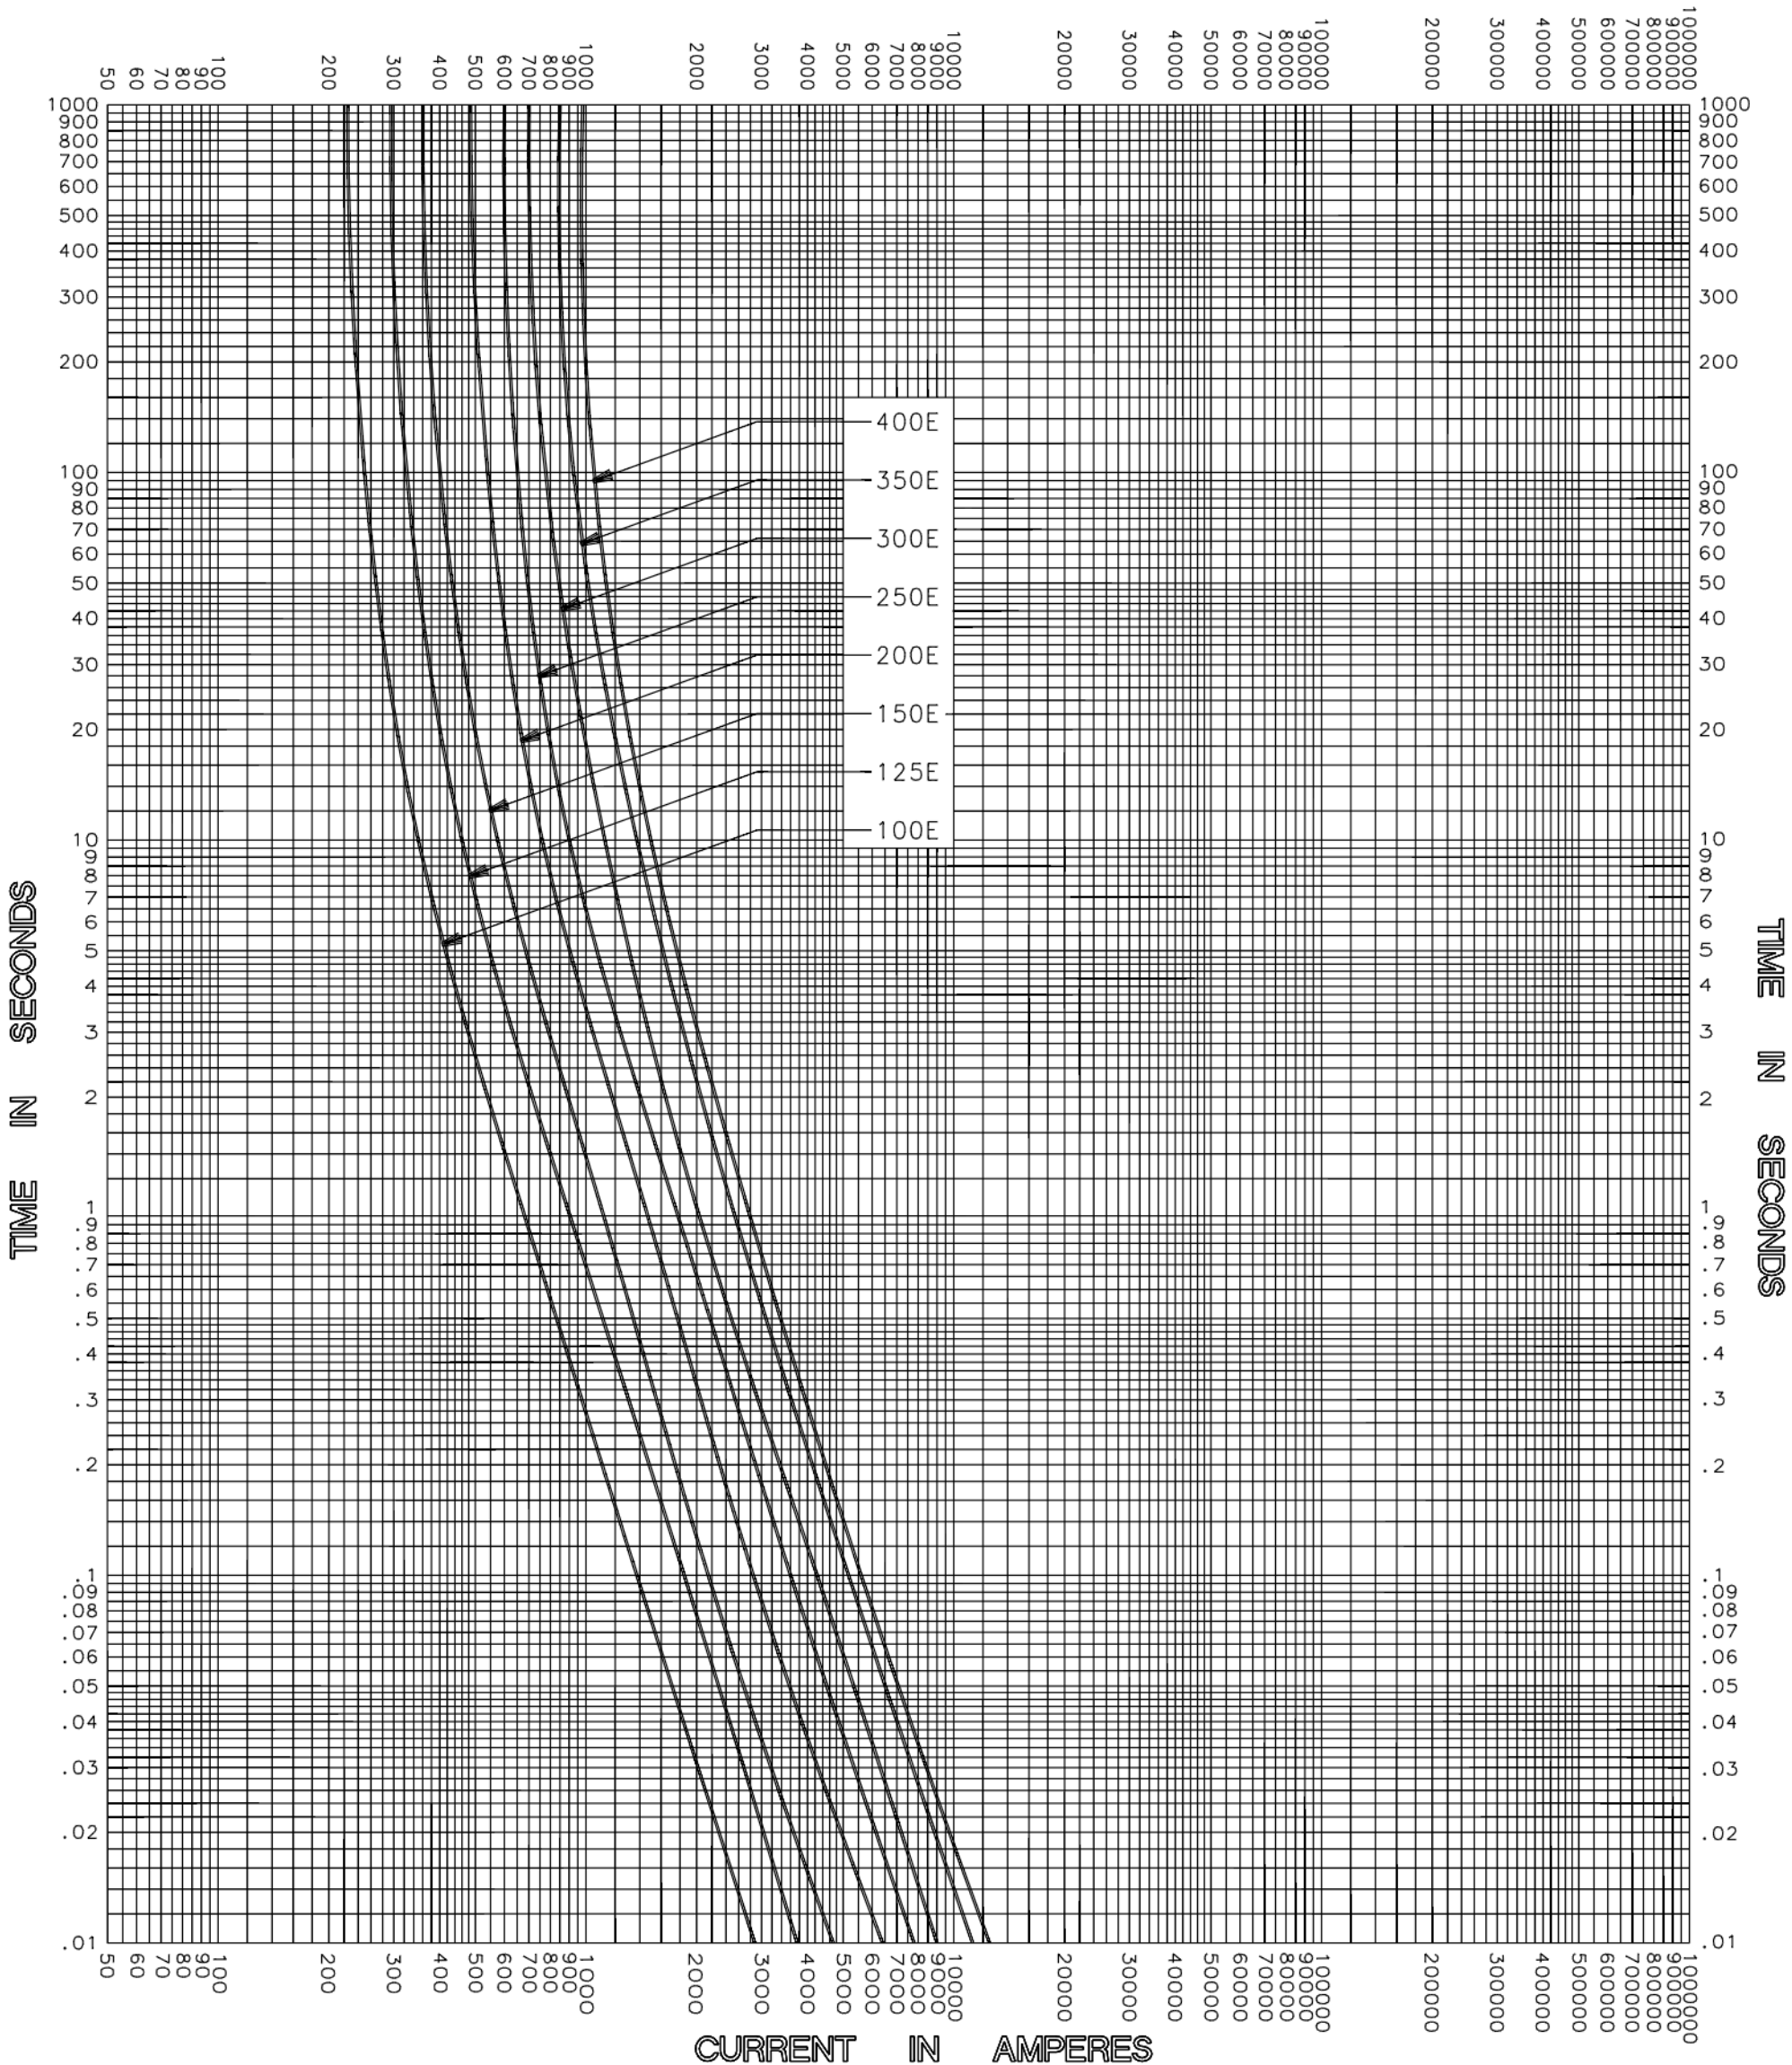

DRAWN BY	LLL
DATE	04/26/04
CHECKED BY	MP
DRAWING NO.	A-FCC04-2.75E-002

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT